


# Filter-Ag Plus®

## ENHANCED PERFORMANCE FILTRATION MEDIA

### Installation Recommendations

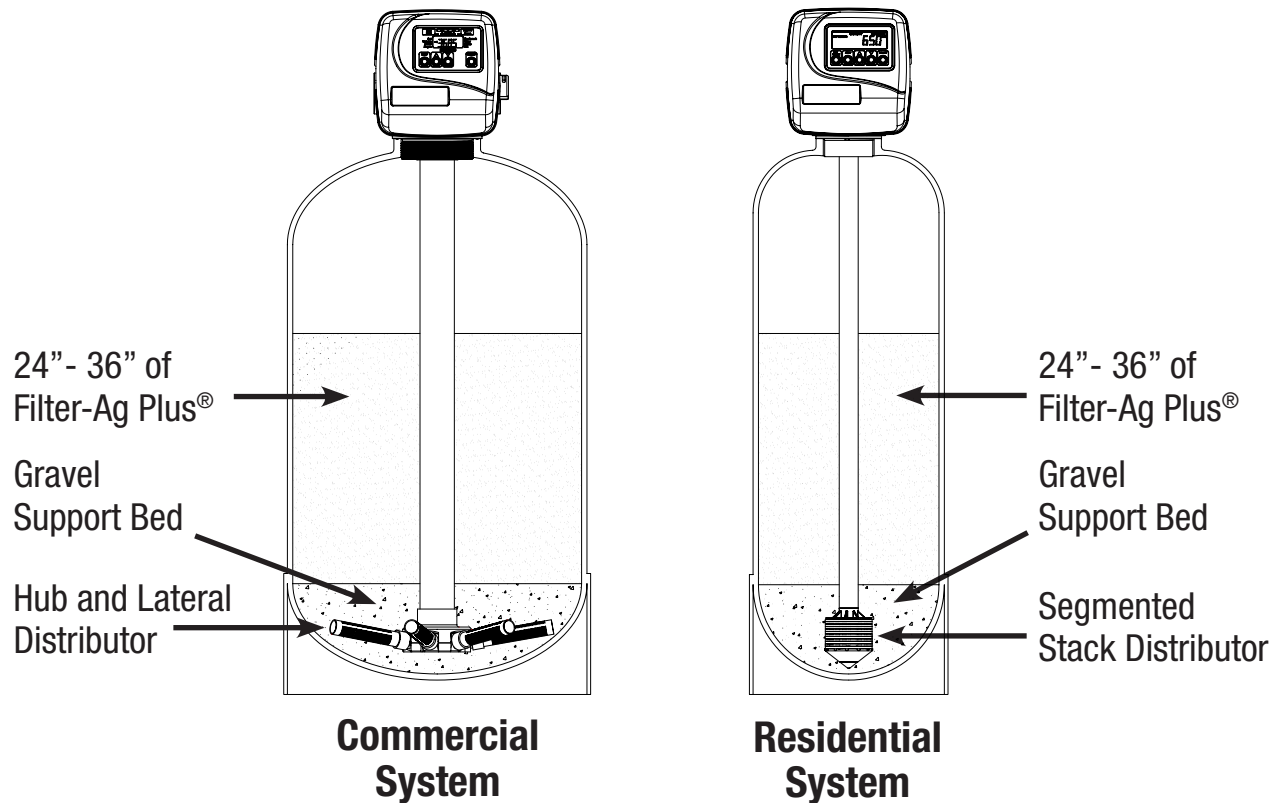

**Before putting Filter-Ag Plus® filter into service follow these recommended instructions or contact the original equipment supplier**

**Slowly fill tank with filter valve in the backwash position until water flows to drain.**

**Backwash at 15 to 20 gpm/sq.ft. for 5 minutes.**

**Let material settle for 5 minutes.**

**Repeat backwash and settle steps for a total of 3 times.**

**Put the filter to service.**

**Important Note: For best results allow Filter-Ag Plus® to sit submerged in water for a minimum of 12 hours prior to following the above procedure and prior to putting the filter to service. A gravel support bed is required.**



www.clackcorp.com

Clack Corporation

4462 DURAFORM LANE • WINDSOR, WISCONSIN 53598-9716 USA  
PHONE (608) 846-3010 FAX (608) 846-2586 SALES/CUSTOMER SERVICE FAX (800) 755-3010

Form No. 2714 • 1/23/2008